
Executive Order G-70-191-AA

Exhibit 2

Figure 2A-2

Typical Installation of the Healy ORVR Phase II Vapor Recovery System

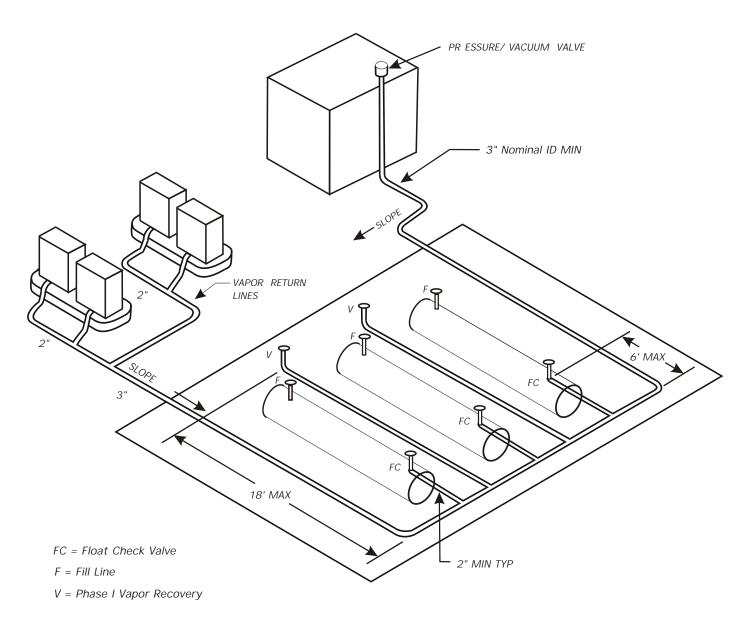

Note: 1. All Vapor/Vent Lines are 3" Nominal ID Minimum

Except as Noted in Exhibit 2 under Vapor Recovery Piping Configurations

2. Slope: 1/8" per foot Min.

1/4" per Foot Prefered